


NFPA® 241

Standard for Safeguarding Construction, Alteration, and Demolition Operations 2009 Edition



NFPA, 1 Batterymarch Park, Quincy, MA 02169-7471
An International Codes and Standards Organization

IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA DOCUMENTS

NOTICE AND DISCLAIMER OF LIABILITY CONCERNING THE USE OF NFPA DOCUMENTS

NFPA codes, standards, recommended practices, and guides, of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in its codes and standards.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on this document. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making this document available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of this document. Nor does the NFPA list, certify, test or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

FOR INDIVIDUAL USE ONLY

ADDITIONAL NOTICES AND DISCLAIMERS

Updating of NFPA Documents

Users of NFPA codes, standards, recommended practices, and guides should be aware that these documents may be superseded at any time by the issuance of new editions or may be amended from time to time through the issuance of Tentative Interim Amendments. An official NFPA document at any point in time consists of the current edition of the document together with any Tentative Interim Amendments and any Errata then in effect. In order to determine whether a given document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments or corrected through the issuance of Errata, consult appropriate NFPA publications such as the National Fire Codes® Subscription Service, visit the NFPA website at www.nfpa.org, or contact the NFPA at the address listed below.

Interpretations of NFPA Documents

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights asserted in connection with any items which are mentioned in or are the subject of NFPA codes, standards, recommended practices, and guides, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on these documents. Users of these documents are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

NFPA adheres to applicable policies of the American National Standards Institute with respect to patents. For further information contact the NFPA at the address listed below.

Law and Regulations

Users of these documents should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

This document is copyrighted by the NFPA. It is made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making this document available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to this document.

Use of NFPA documents for regulatory purposes should be accomplished through adoption by reference. The term "adoption by reference" means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA documents, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA codes, standards, recommended practices, and guides and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA documents during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

For more information about NFPA, visit the NFPA website at www.nfpa.org.

Copyright © 2008 National Fire Protection Association®. All Rights Reserved.

NFPA® 241

Standard for

Safeguarding Construction, Alteration, and Demolition Operations

2009 Edition

This edition of NFPA 241, *Standard for Safeguarding Construction, Alteration, and Demolition Operations*, was prepared by the Technical Committee on Construction and Demolition. It was issued by the Standards Council on December 9, 2008, with an effective date of December 29, 2008, and supersedes all previous editions.

This edition of NFPA 241 was approved as an American National Standard on December 29, 2008.

Origin and Development of NFPA 241

Work on the subject of construction, alteration, and demolition operations began in 1930 when the NFPA Committee on Construction Operations developed the document, *Recommended Good Practice Requirements for Building Construction Operations*. This text was adopted by the NFPA, with revisions, in 1933. In 1942, a tentative revision was submitted, and, while no official action was taken, the revision was published subsequently for information purposes in Volume III of the *National Fire Codes*® published by the NFPA.

The NFPA Committee on Building Construction had jurisdiction over this standard when a tentative text prepared by that committee was adopted at the 1957 NFPA Annual Meeting. That text was unanimously approved by the NFPA in 1958. Complete revisions were adopted by the NFPA in 1968 and 1973. An editorial revision was approved in 1975 that brought the standard into conformance with the NFPA *Manual of Style*. The standard was substantively reconfirmed in 1980.

When the document was reconfirmed in 1980, it came under the Technical Committee on Building Construction. The 1986 edition represented a complete rewrite, which was the result of a comprehensive review by the committee. The 1986 update changed the format in which the safeguards were presented. Chapters 1 through 5 were general in nature and applied to both construction and demolition processes. Chapter 6 presented the specifics associated only with construction processes. Chapter 7 addressed the specifics of demolition. A new Chapter 8 included mandatory references with which various provisions of the standard were required to comply. Nearly 20 codes and standards were referenced in a mandatory fashion.

The 1986 edition also expanded the treatment of items related to an overall construction and demolition fire safety plan. Definitions were expanded and added to cover terms with meanings that were unique to the standard. Temporary heating equipment was required to be listed. The section on smoking was expanded. Trash disposal was broadened to include housekeeping. Outside chutes, fire cutoffs, and explosives used in demolition were addressed. Material on temporary standpipes was included in this edition.

The 1989 edition included a complete rewrite of the section on roofing operations and greatly expanded the associated appendix items to address torch-applied roofing in additional detail. A new chapter on underground operations was added.

Revisions to the 1993, 1996, and the 2000 editions mainly consisted of reformatting and clarifications.

The 2004 edition changes mainly consisted of the elimination of exceptions and the reversal of units of measurement for compliance with the *Manual of Style for NFPA Technical Committee Documents*.

Revisions for the 2009 edition include a requirement for a 2-hour fire watch following torch-applied roofing operations and new provisions for exterior trash chutes.

Technical Committee on Construction and Demolition

Clarence D. Eggen, *Chair*
U.S. Department of Energy, WA [U]

William Ambrefe, City of Beverly, MA [E]
Michael E. Carsillo, West Palm Beach Fire Rescue, FL [E]
Richard J. Davis, FM Global, MA [I]
Michael DeBlasio, M. DeBlasio, Incorporated, MA [IM]
Grant O. Epler, Whitney Atwood Norcross Associates Inc. Architects, MA [U]
Daniel L. Haynes, Lawrence Livermore National Laboratory, CA [U]
Michael G. Kraft, State of Ohio, OH [E]
Alan Landman, New York State Workers Compensation Board, NY [E]
Thomas C. Mc Nerney, Thomas C. Mc Nerney & Associates, WA [SE]

Scott G. Nacheman, LZA Technology/Thornton-Tomasetti Engineers, IL [SE]
Robert Notholt, Florida State Fire Marshal, FL [E]
Jon W. Pasqualone, Martin County Board of County Commissioners, FL [E]
Rep. International Fire Marshals Association
Rick Stallings, City of Hoover, AL [E]
Rep. International Code Council
Craig R. Studer, The RJA Group, Inc., CA [SE]
Ronald W. Woodfin, TetraTek, Inc. Fire Safety Technologies, TX [SE]

Alternates

Donald G. Goosman, The RJA Group, Inc., IL [SE]
(Alt. to C. R. Studer)
David M. Hope, TetraTek Inc. Fire Safety Technologies, TX [SE]
(Alt. to R. W. Woodfin)

Brian L. Marburger, St. Paul Travelers, CT [I]
(Alt. to St. Paul Travelers Rep.)

Gregory E. Harrington, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on the identification and control of fire hazards associated with the construction, alteration, and demolition of buildings, tunnels, and bridges not otherwise covered by other NFPA standards.



Contents

Chapter 1 Administration	241- 4	Chapter 8 Safeguarding Construction and Alteration Operations	241- 9
1.1 Scope	241- 4	8.1 General	241- 9
1.2 Purpose	241- 4	8.2 Scaffolding, Shoring, and Forms	241- 9
1.3 Application	241- 4	8.3 Construction Material and Equipment Storage	241-10
1.4 Equivalency	241- 4	8.4 Permanent Heating Equipment	241-10
1.5 Units and Formulas	241- 4	8.5 Utilities	241-10
Chapter 2 Referenced Publications	241- 4	8.6 Building Separation Walls	241-10
2.1 General	241- 4	8.7 Fire Protection During Construction	241-10
2.2 NFPA Publications	241- 4	Chapter 9 Safeguarding Roofing Operations	241-11
2.3 Other Publications	241- 4	9.1 General	241-11
2.4 References for Extracts in Mandatory Sections. (Reserved)	241- 5	9.2 Asphalt and Tar Kettles	241-11
Chapter 3 Definitions	241- 5	9.3 Single-Ply and Torch-Applied Roofing Systems	241-11
3.1 General	241- 5	9.4 Fire Extinguishers for Roofing Operations	241-12
3.2 NFPA Official Definitions	241- 5	9.5 Fuel for Roofing Operations	241-12
3.3 General Definitions	241- 5	Chapter 10 Safeguarding Demolition Operations	241-12
Chapter 4 Temporary Construction, Equipment, and Storage	241- 5	10.1 General	241-12
4.1 Application	241- 5	10.2 Special Precautions	241-12
4.2 Temporary Offices and Sheds	241- 5	10.3 Temporary Heating Equipment	241-12
4.3 Temporary Enclosures	241- 6	10.4 Smoking	241-12
4.4 Equipment	241- 6	10.5 Demolition Using Explosives	241-12
Chapter 5 Processes and Hazards	241- 6	10.6 Utilities	241-13
5.1 Hot Work	241- 6	10.7 Fire Cutoffs	241-13
5.2 Temporary Heating Equipment	241- 6	10.8 Fire Protection During Demolition	241-13
5.3 Smoking	241- 7	Chapter 11 Safeguarding Underground Operations	241-13
5.4 Waste Disposal	241- 7	11.1 General	241-13
5.5 Flammable and Combustible Liquids and Flammable Gases	241- 7	11.2 Emergency Procedures	241-13
5.6 Explosive Materials	241- 7	11.3 Fire Detection, Protection, and Communications Systems	241-13
Chapter 6 Utilities	241- 7	11.4 Electrical	241-14
6.1 Electrical	241- 7	11.5 Hazardous Operations and Procedures	241-14
Chapter 7 Fire Protection	241- 8	11.6 Storage	241-15
7.1 Fire Safety Program	241- 8	11.7 Equipment	241-15
7.2 Owner's Responsibility for Fire Protection	241- 8	Annex A Explanatory Material	241-15
7.3 Installation, Testing, and Maintenance	241- 8	Annex B Informational References	241-20
7.4 Fire Alarm Reporting	241- 8	Index	241-21
7.5 Access for Fire Fighting	241- 8		
7.6 Standpipes	241- 9		
7.7 First-Aid Fire-Fighting Equipment	241- 9		
7.8 Means of Egress	241- 9		

NFPA 241

Standard for

Safeguarding Construction, Alteration, and Demolition Operations

2009 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading "Important Notices and Disclaimers Concerning NFPA Documents." They can also be obtained on request from NFPA or viewed at www.nfpa.org/disclaimers.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

Changes other than editorial are indicated by a vertical rule beside the paragraph, table, or figure in which the change occurred. These rules are included as an aid to the user in identifying changes from the previous edition. Where one or more complete paragraphs have been deleted, the deletion is indicated by a bullet (•) between the paragraphs that remain.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. As an aid to the user, the complete title and edition of the source documents for extracts in mandatory sections of the document are given in Chapter 2 and those for extracts in informational sections are given in Annex B. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced publications can be found in Chapter 2 and Annex B.

Chapter 1 Administration

1.1* Scope. This standard shall apply to structures in the course of construction, alteration, or demolition, including those in underground locations.

1.2 Purpose. This standard is intended to prescribe minimum safeguards for construction, alteration, and demolition operations in order to provide reasonable safety to life and property from fire during such operations.

1.3 Application.

1.3.1* This standard provides measures for preventing or minimizing fire damage during construction, alteration, and demolition operations.

1.3.2* The public fire department and other fire protection authorities also shall be consulted for guidance.

1.3.3 Alteration activities shall be permitted to require the use of both the demolition and construction activity requirements, as applicable.

1.3.4 A fire safety program shall be included in all construction, alteration, or demolition contracts, and the right of the owner to

administer and enforce this program shall be established, even if the building is entirely under the jurisdiction of the contractor.

1.4 Equivalency. Nothing in this standard is intended to prevent the use of systems, methods, or devices of equivalent or superior quality, strength, fire resistance, effectiveness, durability, and safety over those prescribed by this standard.

1.5 Units and Formulas.

1.5.1 SI Units. Metric units of measurement in this standard are in accordance with the modernized metric system known as the International System of Units (SI).

1.5.2 Primary Values. The SI value for a measurement and the inch-pound value given in parentheses shall each be acceptable for use as primary units for satisfying the requirements of this standard.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

2.2 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 10, *Standard for Portable Fire Extinguishers*, 2007 edition.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 2007 edition.

NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*, 2007 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 2008 edition.

NFPA 31, *Standard for the Installation of Oil-Burning Equipment*, 2006 edition.

NFPA 51, *Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting, and Allied Processes*, 2007 edition.

NFPA 51B, *Standard for Fire Prevention During Welding, Cutting, and Other Hot Work*, 2009 edition.

NFPA 54, *National Fuel Gas Code*, 2009 edition.

NFPA 58, *Liquefied Petroleum Gas Code*, 2008 edition.

NFPA 70®, *National Electrical Code®*, 2008 edition.

NFPA 70E®, *Standard for Electrical Safety in the Workplace®*, 2009 edition.

NFPA 80, *Standard for Fire Doors and Other Opening Protectives*, 2007 edition.

NFPA 101®, *Life Safety Code®*, 2009 edition.

NFPA 130, *Standard for Fixed Guideway Transit and Passenger Rail Systems*, 2007 edition.

NFPA 211, *Standard for Chimneys, Fireplaces, Vents, and Solid Fuel-Burning Appliances*, 2006 edition.

NFPA 495, *Explosive Materials Code*, 2006 edition.

NFPA 701, *Standard Methods of Fire Tests for Flame Propagation of Textiles and Films*, 2004 edition.

NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*, 2007 edition.

NFPA 1963, *Standard for Fire Hose Connections*, 2009 edition.

2.3 Other Publications.

2.3.1 ACGIH Publications. American Conference of Governmental Industrial Hygienists, 1330 Kemper Meadow Drive, Cincinnati, OH 45240-1634.

Threshold Limit Values and Biological Exposure Indices for 1992-1993.

2.3.2 Other Publications.

Merriam-Webster's Collegiate Dictionary, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

2.4 References for Extracts in Mandatory Sections. (Reserved)

NFPA 51B, *Standard for Fire Prevention During Welding, Cutting, and Other Hot Work*, 2009 edition.

Chapter 3 Definitions

3.1 General. The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster's Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1* Approved. Acceptable to the authority having jurisdiction.

3.2.2* Authority Having Jurisdiction (AHJ). An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

3.2.3* Listed. Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

3.2.4 Shall. Indicates a mandatory requirement.

3.2.5 Should. Indicates a recommendation or that which is advised but not required.

3.3 General Definitions.

3.3.1* Hot Work. Work involving burning, welding, or a similar operation that is capable of initiating fires or explosions. [51B, 2009]

3.3.2* Qualified Agency. Any individual, firm, corporation, or company that, either in person or through a representative, is regularly engaged in such work, is trained and familiar with all precautions required, and has complied with all the requirements of the authority having jurisdiction.

3.3.3 Roofing Kettle. Any container in excess of a 56.8 L (15 gal) capacity used for preheating tar, asphalt, pitch, or similar substances for waterproofing.

3.3.4 Roofing System.

3.3.4.1 Single-Ply Roofing System. A single-layer roof covering made of plastic, synthetic rubber, or modified bitumen.

3.3.4.2 Torch-Applied Roofing System. A bituminous roofing system using membranes that are adhered by heating with a torch and melting an asphalt backcoating instead of mopping hot asphalt for adhesion.

3.3.5* Structure. That which is built or constructed and limited to buildings and nonbuilding structures.

3.3.5.1 Protected Structure. A structure equipped with operational automatic sprinkler systems or Class I, II, or III wet standpipe or dry standpipe systems for fire department use.

3.3.5.2 Underground Structure. A structure located in an underground tunnel, a shaft, a chamber, or a passageway; or cut and covered excavation.

3.3.6 Thermal Spraying. A group of welding or allied processes in which finely divided metallic or nonmetallic materials are deposited in a molten or semimolten condition to form a coating. The coating material shall be permitted to be in the form of a powder, a ceramic rod, a wire, or molten materials.

3.3.7 Thermit Welding. A welding process that produces coalescence of metals by heating them with superheated liquid metal resulting from a chemical reaction between a metal oxide and aluminum, with or without the application of pressure. Filler metal, where used, is obtained from the liquid metal.

3.3.8 Tunnel. An underground structure with a design length over 23 m (75 ft) and a 1800 mm (6 ft) diameter.

Chapter 4 Temporary Construction, Equipment, and Storage

4.1 Application. For the purposes of Chapter 4, the term *temporary* shall be defined as the duration of the construction project.

4.2 Temporary Offices and Sheds.

4.2.1* Separation distances between buildings under construction and construction-related structures, such as temporary offices, trailers, sheds, and other facilities for the storage of tools and materials having combustible construction or contents, shall be in accordance with Table 4.2.1.

Table 4.2.1 Separation Distances

Temporary Structure Exposing Wall Length		Minimum Separation Distance	
m	ft	m	ft
6	20	9	30
9	30	11	35
12	40	12	40
15	50	14	45
18	60	15	50
>18	>60	18	60

Notes:

(1) Where the separation distance between temporary structures is less than the minimum separation distance, then the exposing wall length shall be considered to be the sum of the individual exposing wall lengths of the temporary structures.

(2) A 75 percent reduction in separation distances shall be permitted to be applied, provided automatic sprinkler protection is used in the exposing structure.

(3) The separation distances apply to single-level structures only. This table does not apply to multilevel, unsprinklered structures. A level, where applying this table, is 3600 mm (144 in.).

4.2.2* Detachment between temporary structures, adequate temporary fixed fire protection systems, and portable equipment shall be provided as required by the authority having jurisdiction.

4.2.3 Only safely installed approved heating devices shall be used in temporary offices and sheds.

4.2.4 Clearance shall be provided around stoves, heaters, and all chimney and vent connectors to prevent ignition of adjacent combustible materials in accordance with NFPA 31, *Standard for the Installation of Oil-Burning Equipment* (liquid fuel devices); NFPA 54, *National Fuel Gas Code* (fuel gas devices); and NFPA 211, *Standard for Chimneys, Fireplaces, Vents, and Solid Fuel-Burning Appliances* (connectors and solid fuel). (Where temporary heating devices are used, see Section 5.2.)

4.3 Temporary Enclosures.

4.3.1 Only noncombustible panels, flame-resistant tarpaulins, or approved materials of equivalent fire-retardant characteristics shall be used.

4.3.2 Any other fabrics or plastic films used shall be certified as conforming to the requirements of Test Method #2 contained in NFPA 701, *Standard Methods of Fire Tests for Flame Propagation of Textiles and Films*.

4.3.3 Where used to enclose structures, forming equipment, and similar items, the enclosing material shall be fastened securely or guarded by construction so it cannot be blown by the wind against heaters or other sources of ignition.

4.3.4 Fire Extinguishers.

4.3.4.1 Temporary enclosures shall be equipped with a minimum of one fire extinguisher suitable for all classes of fires that are expected inside the enclosure.

4.3.4.2 Fire extinguishers shall be located so that travel distance to a fire extinguisher does not exceed 15 m (50 ft).

4.4 Equipment.

4.4.1* Internal combustion engines and associated equipment, such as air compressors, hoists, derricks, pumps, and similar devices, shall be located so that the exhausts discharge well away from combustible materials.

4.4.2 Where the exhausts are piped outside the structure under construction, alteration, or demolition, a clearance of at least 230 mm (9 in.) shall be maintained between such piping and combustible material.

4.4.3 Internal combustion engines and associated equipment shall be shut down and allowed to cool sufficiently prior to refueling.

4.4.4 Service areas for equipment shall not be located within structures under construction, alteration, or demolition.

4.4.5 Fuel for internal combustion engines shall not be stored within structures under construction, alteration, or demolition, unless otherwise permitted in Section 5.5.

ing Welding, Cutting, and Other Hot Work, except as modified in Chapter 9.

5.1.2 Gas-operated cutting and welding equipment using multiple oxygen and fuel gas cylinders shall be in accordance with NFPA 51, *Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting, and Allied Processes*.

5.1.3 Fire Watch.

5.1.3.1 Fire watches shall be assigned no other duties.

5.1.3.2 A fire watch shall be posted for the duration of the work and for 2 hours thereafter for torch-applied roofing operations (see 9.3.9).

5.1.4 Thermit Welding.

5.1.4.1* In Thermit welding, the mold shall be dried thoroughly before the charge is ignited and provided with a cover.

5.1.4.2* Bulk storage of Thermit welding materials shall be maintained in a detached shed at least 15 m (50 ft) from the main buildings.

5.1.4.3 Storage sheds shall be maintained dry, posted as a “no smoking” area, and kept locked.

5.1.4.4 Containers for the starting material shall be closed tightly immediately after each use.

5.1.4.5 The molds shall not be removed until sufficient cooling has taken place in accordance with the manufacturer’s published instructions.

5.1.4.6 Smoking shall not be permitted in areas where Thermit welding material is being used.

5.2 Temporary Heating Equipment.

5.2.1 Temporary heating equipment shall be listed and shall be installed, used, and maintained in accordance with the manufacturer’s instructions.

5.2.2 Chimney or vent connectors, where required from direct-fired heaters, shall be maintained at least 460 mm (18 in.) from combustibles and shall be installed in accordance with NFPA 211, *Standard for Chimneys, Fireplaces, Vents, and Solid Fuel-Burning Appliances*.

5.2.3 Oil-fired heaters shall comply in design and installation features with NFPA 31, *Standard for the Installation of Oil-Burning Equipment*.

5.2.4 Fuel supplies for liquefied petroleum gas-fired heaters shall comply with NFPA 54, *National Fuel Gas Code*, and NFPA 58, *Liquefied Petroleum Gas Code*.

5.2.5* Refueling operations shall be conducted in an approved manner.

5.2.6 Heating devices shall be situated so that they are secured.

5.2.7 Heating devices shall be installed in accordance with their listing, including clearance to combustible material, equipment, or construction.

5.2.8* Temporary heating equipment, where utilized, shall be monitored for safe operation and maintained by properly trained personnel.

Chapter 5 Processes and Hazards

5.1 Hot Work.

5.1.1* Responsibility for hot work operations and fire prevention precautions, including permits and fire watches, shall be in accordance with NFPA 51B, *Standard for Fire Prevention Dur-*

5.3 Smoking.

5.3.1* Smoking shall be prohibited at or in the vicinity of hazardous operations or combustible/flammable materials. “No smoking” signs shall be posted in these areas.

5.3.2 Smoking shall be permitted only in designated areas.

5.3.3 Where smoking is permitted, safe receptacles for smoking materials shall be provided.

5.4 Waste Disposal.

5.4.1* Accumulations of combustible waste material, dust, and debris shall be removed from the structure and its immediate vicinity at the end of each work shift or more frequently as necessary for safe operations.

5.4.2 Rubbish shall not be burned on the premises without first obtaining a permit from the authority having jurisdiction.

5.4.3 Materials susceptible to spontaneous ignition, such as oily rags, shall be stored in a listed disposal container.

5.4.4 Trash chutes, where provided, shall comply with 5.4.4.1 through 5.4.4.6.

5.4.4.1* A trash chute safety plan shall be submitted to and approved by the authority having jurisdiction.

5.4.4.2 Trash chutes used on the exterior of a building shall be of noncombustible construction, or protected in accordance with 5.4.4.3 through 5.4.4.6 if of combustible construction.

5.4.4.3* The interior of combustible trash chutes shall be provided with not less than one temporary automatic sprinkler within a recess near the top of the chute.

5.4.4.4 The temporary sprinkler required by 5.4.4.3 shall be protected by the recess as well as a listed sprinkler guard.

5.4.4.5 The temporary sprinkler required by 5.4.4.3 shall be connected to any available water supply with a listed fire hose, or a flexible, commercial rubber hose, with a diameter of not less than 19 mm (¾ in.) and a listed flexible connector.

5.4.4.6 The temporary sprinkler required by 5.4.4.3 shall be protected against freezing where required by the authority having jurisdiction.

5.5 Flammable and Combustible Liquids and Flammable Gases.

5.5.1 Storage.

5.5.1.1 Storage of flammable and combustible liquids shall be in accordance with NFPA 30, *Flammable and Combustible Liquids Code*, unless otherwise modified by this section.

5.5.1.2* Storage of Class I and Class II liquids shall not exceed 227 L (60 gal) within 15 m (50 ft) of the structure.

5.5.1.3 Storage areas shall be kept free of weeds, debris, and combustible materials not necessary to the storage.

5.5.1.4 Open flames and smoking shall not be permitted in flammable and combustible liquids storage areas.

5.5.1.5 Such storage areas shall be appropriately posted as “no smoking” areas.

5.5.1.6 Storage areas shall be appropriately posted with markings in accordance with NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*.

5.5.2 Handling of Flammable and Combustible Liquids at Point of Final Use.

5.5.2.1 Handling of flammable and combustible liquids shall be in accordance with NFPA 30, *Flammable and Combustible Liquids Code*, except as modified by 5.5.2.2 through 5.5.2.4.

5.5.2.2 Class I and Class II liquids shall be kept in approved safety containers.

5.5.2.3 Means shall be provided to dispose of leakage and spills promptly and safely.

5.5.2.4* Class I liquids shall be dispensed only where there are no open flames or other sources of ignition within the possible path of vapor travel.

5.5.3 Storage and Handling of Combustible and Flammable Gases.

5.5.3.1 Storage and handling of combustible and flammable gases shall be in accordance with NFPA 54, *National Fuel Gas Code*, and NFPA 58, *Liquefied Petroleum Gas Code*.

5.5.3.2 Open flames and smoking shall not be permitted in flammable gas storage areas.

5.6 Explosive Materials.

5.6.1 The storage, handling, and use of explosive materials shall be in accordance with NFPA 495, *Explosive Materials Code*.

5.6.2 All blasting operations shall be under the direct supervision of an individual who is legally licensed to use explosives and who possesses the required permits.

Chapter 6 Utilities

6.1 Electrical.

6.1.1 All construction-operation electrical wiring and equipment for light, heat, or power purposes shall be in accordance with the applicable provisions of NFPA 70, *National Electrical Code*.

6.1.1.1 Electrical devices shall be maintained in a safe condition.

6.1.1.2 Extension cords shall be maintained free from damage.

6.1.1.3 Damaged equipment and cords shall be removed from service until rendered safe.

6.1.2 Temporary Wiring.

6.1.2.1 Branch Circuits. All branch circuits shall originate in an approved power outlet or panelboard.

6.1.2.2 Conductors shall be permitted within multiconductor cord or cable assemblies or as open conductors.

6.1.2.3 All conductors shall be protected by overcurrent devices rated for the ampacity of the conductors.

6.1.2.4 Runs of open conductors shall be located where the conductors are not subject to physical damage, and the conductors shall be fastened at intervals not exceeding 3 m (10 ft).

6.1.2.5 Each branch circuit that supplies receptacles or fixed equipment shall contain a separate equipment grounding conductor where run as an open conductor.

6.1.3 Lighting.

6.1.3.1 Temporary lights shall be equipped with guards to prevent accidental contact with the bulb unless the construction of the reflector is such that the bulb is deeply recessed.

6.1.3.2 Temporary lighting fixtures, such as quartz, that operate at temperatures capable of igniting ordinary combustibles shall be fastened securely so that the possibility of their coming in contact with such materials is precluded.

6.1.3.3 Temporary lights shall be equipped with heavy-duty electrical cords with connections and insulation maintained in safe condition.

6.1.3.4 Temporary lights shall not be suspended by their electrical cords unless such cords and lights have been designed for that purpose.

6.1.3.5 Splices shall have insulation equivalent to that of the cable.

6.1.3.6 Temporary wiring shall be removed immediately upon the completion of the construction or purpose for which the wiring was installed.

Chapter 7 Fire Protection

7.1 Fire Safety Program. An overall construction or demolition fire safety program shall be developed. Essential items to be emphasized include the following:

- (1) Good housekeeping
- (2) On-site security
- (3) Installation of new fire protection systems as construction progresses
- (4) Preservation of existing systems during demolition
- (5) Organization and training of an on-site fire brigade
- (6) Development of a prefire plan with the local fire department
- (7) Rapid communication
- (8) Consideration of special hazards resulting from previous occupancies
- (9) Protection of existing structures and equipment from exposure fires resulting from construction, alteration, and demolition operations

7.2 Owner's Responsibility for Fire Protection.

7.2.1* The owner shall designate a person who shall be responsible for the fire prevention program and who shall ensure that it is carried out to completion.

7.2.1.1 The fire prevention program manager shall have the authority to enforce the provisions of this and other applicable fire protection standards.

7.2.1.2 The fire prevention program manager shall have knowledge of the applicable fire protection standards, available fire protection systems, and fire inspection procedures.

7.2.1.3 Inspection records shall be available for review by the authority having jurisdiction.

7.2.2 Where guard service is provided, the fire prevention program manager shall be responsible for the guard service.

7.2.3* Prefire Plans.

7.2.3.1 Where there is public fire protection or a private fire brigade, the manager shall be responsible for the development of prefire plans in conjunction with the fire agencies.

7.2.3.2 Prefire plans shall be updated as necessary.

7.2.3.3 The prefire plan shall include provisions for on-site visits by the fire agency.

7.2.4 Program Manager Responsibilities.

7.2.4.1 The manager shall be responsible for ensuring that proper training in the use of protection equipment has been provided.

7.2.4.2 The manager shall be responsible for the presence of adequate numbers and types of fire protection devices and appliances and for their proper maintenance.

7.2.4.3 The manager shall be responsible for supervising the permit system for hot work operations. (*See Section 5.1.*)

7.2.4.4 A weekly self-inspection program shall be implemented, with records maintained and made available.

7.2.4.5* Impairments to the fire protection systems or fire alarm, detection, or communications systems shall be authorized only by the fire prevention program manager.

7.2.4.6 Temporary protective coverings used on fire protection devices during renovations, such as painting, shall be removed promptly when work has been completed in the area.

7.2.5 Site Security.

7.2.5.1* Guard service shall be provided where required by the authority having jurisdiction.

7.2.5.2* Where guard service is provided, the guard(s) shall be trained in the following:

- (1) Notification procedures that include calling the fire department and management personnel
- (2) Knowledge of fire protection equipment
- (3) Familiarization with fire hazards
- (4) Use of construction elevators

7.2.5.3 Guards shall be informed of any special status of emergency equipment or hazards.

7.2.5.4* Security fences shall be provided where required by the authority having jurisdiction.

7.2.5.5* Entrances (e.g., doors and windows) to the structure under construction, alteration, or demolition shall be secured where required by the authority having jurisdiction.

7.3 Installation, Testing, and Maintenance. Where fire alarm, detection, or protection systems are required, they shall be installed, maintained, and tested in accordance with the appropriate NFPA standards. (*See Chapter 2.*)

7.4* Fire Alarm Reporting.

7.4.1 There shall be a readily available public fire alarm box near the premises, telephone service to the responding fire department, or equivalent facilities.

7.4.2 Instructions shall be issued for the immediate notification of the fire department in the case of a fire. Where telephone service is employed, the local fire department number and site address shall be conspicuously posted near each telephone.

7.5 Access for Fire Fighting.

7.5.1 A suitable location at the site shall be designated as a command post and provided with plans, emergency information, keys, communications, and equipment, as needed.

7.5.2 The person in charge of fire protection shall respond to the location command post whenever fire occurs.

7.5.3 Where access to or within a structure or an area is unduly difficult because of secured openings or where immediate access is necessary for life-saving or fire-fighting purposes, the authority having jurisdiction shall be permitted to require a key box to be installed in an accessible location.

7.5.4 The key box shall be an approved type and shall contain keys to gain access as required by the authority having jurisdiction.

7.5.5 Access Roadways.

7.5.5.1 Every building shall be accessible by fire department apparatus by means of roadways having an all-weather driving surface of not less than 6100 mm (240 in.) of unobstructed width, having the ability to withstand the live loads of fire apparatus, and having a minimum of 4100 mm (162 in.) of vertical clearance.

7.5.5.2 Access for use of fire department apparatus shall be provided to the immediate job site at the start of the project and maintained until completion.

7.5.5.3 Dead-end fire department access roads in excess of 46 m (150 ft) in length shall be provided with approved provisions for turning around fire department apparatus unless otherwise permitted by 7.5.5.4.

7.5.5.4 The requirements of 7.5.5.1 through 7.5.5.3 shall be permitted to be modified where, in the opinion of the fire department, fire-fighting or rescue operations would not be impaired by such modification.

7.5.5.5 The required width of access roadways shall not be obstructed in any manner, including obstruction by parked vehicles.

7.5.5.6 “No parking” signs or other appropriate notices, or both, prohibiting obstruction shall be permitted to be required and shall be maintained.

7.5.5.7 The access roadway shall be extended to within 46 m (150 ft) of all portions of the exterior walls of the first story of any building.

7.5.5.8 Where an access roadway cannot be provided, an approved fire protection system or systems shall be provided as required and approved by the authority having jurisdiction.

7.5.5.9 Where a bridge is required to be used as access, it shall be constructed and maintained using design live loading sufficient to carry the imposed loads of the fire apparatus.

7.5.6 Stairs.

7.5.6.1 In all buildings over one story in height, at least one stairway shall be provided that is in usable condition at all times and that meets the requirements of NFPA 101, *Life Safety Code*.

7.5.6.2 This stairway shall be extended upward as each floor is installed in new construction and maintained for each floor still remaining during demolition.

7.5.6.3 The stairway shall be lighted.

7.5.6.4 During construction, the stairway shall be enclosed where the building exterior walls are in place.

7.5.6.5 All exit stairs shall be provided with stair identification signs to include the floor level, stair designation, and exit path direction as required to provide for safe egress.

7.5.7 Hoists and Elevators. Where hoists and elevators provide the only efficient means of transporting hose and other cumbersome fire-fighting equipment to upper floors, they shall be available to the fire department whenever necessary.

7.5.8 Hydrants.

7.5.8.1 Free access from the street to fire hydrants and to outside connections for standpipes, sprinklers, or other fire extinguishing equipment, whether permanent or temporary, shall be provided and maintained at all times.

7.5.8.2 Protective pedestrian walkways shall not be constructed so that they impede access to hydrants.

7.5.8.3 No material or construction shall interfere with access to hydrants, siamese connections, or fire extinguishing equipment.

7.6 Standpipes. In all new buildings in which standpipes are required or where standpipes exist in buildings being altered or demolished, such standpipes shall be maintained in conformity with the progress of building construction in such a manner that they are always ready for use.

7.7* First-Aid Fire-Fighting Equipment.

7.7.1* The suitability, distribution, and maintenance of extinguishers shall be in accordance with NFPA 10, *Standard for Portable Fire Extinguishers*.

7.7.2 Wherever a toolhouse, storeroom, or other shanty is located in or adjacent to the building under construction or demolition, or where a room or space within that building is used for storage, a dressing room, or a workshop, at least one approved extinguisher shall be provided and maintained in an accessible location, unless otherwise permitted by 7.7.3.

7.7.3 The requirement of 7.7.2 shall be permitted to be waived where the structure does not exceed 14 m² (150 ft²) in floor area or is equipped with automatic sprinklers or other approved protection.

7.7.4 At least one approved fire extinguisher also shall be provided in plain sight on each floor at each usable stairway as soon as combustible material accumulates.

7.7.5 Suitable fire extinguishers shall be provided on self-propelled equipment.

7.7.6* Free access to permanent, temporary, or portable first-aid fire equipment shall be maintained at all times.

7.8 Means of Egress. The means of egress shall be provided in accordance with 4.6.11 of NFPA 101, *Life Safety Code*.

Chapter 8 Safeguarding Construction and Alteration Operations

8.1 General. In addition to the specific requirements of this chapter, the provisions of Chapter 1 and Chapters 3 through 7 shall be followed, as applicable, for all construction.

8.2* Scaffolding, Shoring, and Forms.

8.2.1 Accumulations of unnecessary combustible forms or form lumber shall be prohibited.

8.2.2 Combustible forms or form lumber shall be brought into the structure only when needed.

8.2.3 Combustible forms or form lumber shall be removed from the structure as soon as stripping is complete.

8.2.4 Those portions of the structure where combustible forms are present shall not be used for the storage of other combustible building materials.

8.2.5* During forming and stripping operations, portable fire extinguishers or charged hose lines shall be provided to protect the additional combustible loading adequately.

8.3 Construction Material and Equipment Storage.

8.3.1 Temporary storage of equipment to be installed, combustible construction materials, or combustible packing materials shall not be permitted in unprotected structures under construction or alteration unless authorized by the authority having jurisdiction.

8.3.2* Storage shall not be permitted in protected structures until protection is in service.

8.3.3 Yard storage of equipment to be installed or combustible construction materials shall not be stored closer than 9 m (30 ft) from the structure under construction or alteration. (See 4.2.1.)

8.4 Permanent Heating Equipment. The permanent heating equipment for a new building shall be installed and put into operation as soon as practicable.

8.5 Utilities.

8.5.1 General. The provisions of Chapter 6 shall apply in addition to the specific requirements of this section.

8.5.2 Gas.

8.5.2.1 The installation of gas piping for construction purposes, or modifications to existing gas piping, gas utilization equipment, or accessories, shall be performed only by a qualified agency.

8.5.2.2 All such work shall be in accordance with NFPA 54, *National Fuel Gas Code*.

8.5.2.3 All modifications to existing gas piping systems shall be performed with the gas turned off, unless otherwise permitted by 8.5.2.4.

8.5.2.4 Hot taps shall be permitted to be made, provided they are installed by a trained and experienced crew utilizing equipment specifically designed for such purpose.

8.6 Building Separation Walls.

8.6.1 Fire Cutoffs.

8.6.1.1 Fire walls and exit stairways, where required for the completed building, shall be given construction priority for installation.

8.6.1.2 Fire doors with approved closing devices and hardware shall be installed as soon as is practicable and preferably before combustible material is introduced.

8.6.1.3 Fire doors, after installation in accordance with NFPA 80, *Standard for Fire Doors and Other Opening Protectives*, shall not be obstructed from closing.

8.6.2 Temporary Separation Walls.

8.6.2.1 Protection shall be provided to separate an occupied portion of the structure from a portion of the structure undergoing alteration, construction, or demolition operations when such operations are considered as having a higher level of hazard than the occupied portion of the building.

8.6.2.2 Walls shall have at least a 1-hour fire resistance rating.

8.6.2.3 Opening protectives shall have at least a 45-minute fire protection rating.

8.6.2.4* Nonrated walls and opening protectives shall be permitted when an approved automatic sprinkler system is installed.

8.7 Fire Protection During Construction.

8.7.1 General. The provisions of Chapter 7 shall apply in addition to the specific requirements of this section.

8.7.2 Water Supply.

8.7.2.1* A water supply for fire protection, either temporary or permanent, shall be made available as soon as combustible material accumulates.

8.7.2.2 There shall be no delay in the installation of fire protection equipment. (See A.8.2.5.)

8.7.2.3* Where underground water mains and hydrants are to be provided, they shall be installed, completed, and in service prior to commencing construction work on any structure.

8.7.3 Sprinkler Protection.

8.7.3.1* If automatic sprinkler protection is to be provided, the installation shall be placed in service as soon as practicable.

8.7.3.2 The details of installation shall be in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*.

8.7.3.3 Where sprinklers are required for safety to life, the building shall not be occupied until the sprinkler installation has been entirely completed and tested so that the protection is not susceptible to frequent impairment caused by testing and correction, unless otherwise permitted by 8.7.3.4.

8.7.3.4 The provision of 8.7.3.3 shall not prohibit occupancy of the lower floors of a building, even where the upper floors are in various stages of construction or protection, provided the following conditions are satisfied:

- (1) The sprinkler protection of the lower occupied floors is completed and tested in accordance with 8.7.3.3.
- (2) The sprinkler protection of the upper floors is supplied by entirely separate systems and separate control valves so that the absence or incompleteness of protection in no way impairs the sprinkler protection of the occupied lower floors.

8.7.3.5 The operation of sprinkler control valves shall be permitted only by properly authorized personnel and shall be accompanied by the notification of duly designated parties.

8.7.3.6 Where the sprinkler protection is regularly turned off and on to facilitate connection of newly completed segments, the sprinkler control valves shall be checked at the end of each work shift to ascertain that protection is in service.

8.7.4 Standpipes.

8.7.4.1 General.

8.7.4.1.1* The pipe size, hose valves, hose, water supply, and other details for new construction shall be in accordance with NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*.

8.7.4.1.2 On permanent Type II and Type III standpipes, hose and nozzles shall be provided and made ready for use as soon as the water supply is available to the standpipe, unless otherwise permitted by 8.7.4.1.3.

8.7.4.1.3* In combined systems where occupant hose is not required, temporary hose and nozzles shall be provided during construction.

8.7.4.2 Standpipe Installations in Buildings Under Construction. Where required by the authority having jurisdiction, in buildings under construction, a standpipe system, either temporary or permanent in nature, shall be installed in accordance with 8.7.4.2.1 through 8.7.4.2.10.

8.7.4.2.1 The standpipes shall be provided with conspicuously marked and readily accessible fire department connections on the outside of the building at the street level and shall have at least one standard hose outlet at each floor.

8.7.4.2.2 The pipe sizes, hose valves, hose, water supply, and other details for new construction shall be in accordance with this standard.

8.7.4.2.3 The standpipes shall be securely supported and restrained at each alternate floor.

8.7.4.2.4* At least one approved hose valve for attaching fire department hose shall be provided at each intermediate landing or floor level in the exit stairway, as determined by the authority having jurisdiction.

8.7.4.2.5 Valves shall be kept closed at all times and guarded against mechanical injury.

8.7.4.2.6 Hose valves shall have NH standard external threads for the valve size specified in accordance with NFPA 1963, *Standard for Fire Hose Connections*, unless modified by 8.7.4.2.7.

8.7.4.2.7 Where local fire department connections do not conform to NFPA 1963, the authority having jurisdiction shall designate the connection to be used.

8.7.4.2.8* The standpipes shall be extended up with each floor and shall be securely capped at the top.

8.7.4.2.9 Top hose outlets shall be not more than one floor below the highest forms, staging, and similar combustibles at all times.

8.7.4.2.10 Temporary standpipes shall remain in service until the permanent standpipe installation is complete.

Chapter 9 Safeguarding Roofing Operations

9.1 General. All roofing operations involving heat sources and hot processes shall be conducted by a qualified agency.

9.2 Asphalt and Tar Kettles.

9.2.1* Asphalt and tar kettles and associated LP-Gas cylinders shall be located in a safe place outside of the building at a point that avoids the danger of ignition of combustible material.

9.2.2 Asphalt and tar kettles shall not be located on roofs.

9.2.3 A lid that can be closed by means of gravity shall be provided on all roofing kettles.

9.2.4 The tops and covers of all kettles shall be close-fitting and constructed of steel having a thickness of not less than No. 14 manufacturer's standard gauge [2 mm (0.075 in.)].

9.2.5* Used roofing mops and rags shall be cleaned of excessive asphalt and stored away from the building and combustible materials.

9.2.6 Discarded roofing mops and rags shall not be in contact with combustibles.

9.2.7 Kettles shall be constantly attended when in operation by a minimum of one employee knowledgeable of the operations and hazards. The employee shall be within 7600 mm (300 in.) of the kettle and have the kettle within sight.

9.2.8 Roofing kettles shall not block exits, means of egress, gates, roadways, or entrances. In no case shall kettles be closer than 3000 mm (120 in.) from exits or means of egress.

9.3* Single-Ply and Torch-Applied Roofing Systems.

9.3.1* General.

9.3.1.1 Single-ply and torch-applied roofing systems shall be installed using extreme caution.

9.3.1.2 Torches or hot-air guns used to secure roofing membranes shall be used in accordance with the manufacturer's recommendations.

9.3.1.3 In order to prevent smoking or ignition of roofing membranes, they shall not be overheated.

9.3.2* Openings, Penetrations, and Flashings.

9.3.2.1 Caution shall be used where working near roof openings, penetrations, or flashings.

9.3.2.2 The flame of the torch shall not come in direct contact with wood nailers, cant strips, or metal flashing.

9.3.2.3 Small torches shall be used to heat the underside of the membrane at a distance from these areas before securement.

9.3.2.4 Hot trowels shall be used to feather seams at laps and flashings.

9.3.2.5 The torch shall not be used in areas where the flame impingement cannot be fully viewed.

9.3.2.6 Open flames shall not be left unattended.

9.3.3 Flame Contact Protection.

9.3.3.1 The torch flame shall not be applied to a combustible substrate for the membrane.

9.3.3.2 Base ply shall be used to cover wooden decks, combustible insulation (such as foam plastic, kraft-faced glass fiber, or wood fiber), small crevices, cant strips, plastic fastener plates, or any other combustible surface.

9.3.3.3 Base ply shall be permitted to consist of either glass fiber felts or minimum 18 kg (40 lb) organic felts.

9.3.3.4 Torch flames shall not come in contact with exposed plastic roofing cement.

9.3.4 Installation.

9.3.4.1 The installation of torch-applied roofing and, in some cases, single-ply roofing systems is hot work and shall comply with Section 5.1, except where otherwise noted.

9.3.4.2* Torch-applied roofing shall be exempt from the requirement in NFPA 51B, *Standard for Fire Prevention During Welding, Cutting, and Other Hot Work*, that combustibles shall be kept 11 m (35 ft) from hot work, commonly referred to as the “35 Foot Rule.”

9.3.5* Personal Protection. Protective clothing and personal protective equipment shall be worn by installers.

9.3.6 Equipment.

9.3.6.1 Proper equipment shall be used to heat roofing membranes.

9.3.6.2 Torches shall be equipped with a pilot adjustment, a flame height adjustment, a minimum of 7600 mm (300 in.) to a maximum of 15 m (50 ft) of listed hose, a pressure gauge, and a regulator.

9.3.6.3 A spark igniter shall be used.

9.3.6.4 Torch trolleys and multiple torch head machines shall be equipped with listed safety valves.

9.3.7* Equipment Inspection. Equipment shall be inspected thoroughly and repaired or replaced as needed prior to use.

9.3.8* Fuel Gas Cylinders.

9.3.8.1 Fuel gas cylinders shall not be hoisted by their valves.

9.3.8.2 Straps placed around the cylinders shall be utilized.

9.3.8.3 Carts used to transport fuel gas cylinders shall be stable.

9.3.8.4 Safety caps shall be attached to all fuel gas cylinders and installed on the valves whenever cylinders are not in use.

9.3.8.5 The fuel gas cylinder shall be sized for the torch used.

9.3.8.6 Frost Buildup.

9.3.8.6.1 If frost buildup occurs on fuel gas cylinders and the rate of vapor withdrawal is no longer adequate for operating conditions, the cylinder shall not be placed on its side or heated with the torch flame.

9.3.8.6.2 The hose shall be disconnected and a cylinder with greater propane volume shall be used.

9.3.9* Fire Watch. A fire watch shall be conducted for at least 2 hours after torches have been extinguished.

9.4 Fire Extinguishers for Roofing Operations.

9.4.1* There shall be at least one portable fire extinguisher having a rating of not less than 20-B no closer than 1500 mm (60 in.) and no more than 7600 mm (300 in.) of horizontal travel distance from every kettle at all times while such kettle is in operation.

9.4.2 Fire extinguishers shall be located in an accessible, visible, or identified location.

9.4.3* There shall be at least one multipurpose 2-A:20-B:C portable fire extinguisher on the roof being covered or repaired, or other fire protection shall be provided as determined by the authority having jurisdiction.

9.4.4 There shall be at least one multipurpose 2-A:20-B:C portable fire extinguisher within 6100 mm (240 in.) of horizontal travel distance from torch-applied roofing equipment.

9.4.5 All kettle operators and torch-applied roof installers shall be trained in the use of fire extinguishers.

9.5 Fuel for Roofing Operations.

9.5.1 Fuel containers, burners, and related appurtenances of roofing equipment in which liquefied petroleum gas is used for heating shall comply with all the applicable requirements of NFPA 58, *Liquefied Petroleum Gas Code*.

9.5.2 Fuel containers having capacities greater than 0.45 kg (1 lb) shall be located at least 3000 mm (120 in.) from the burner flame or at least 600 mm (24 in.) therefrom where properly insulated from heat or flame.

9.5.3 Solid fuel or Class I liquids shall not be used as fuel for roofing kettles.

9.5.4 LP-Gas cylinders shall be secured to prevent accidental tip over.

9.5.5 Where in the opinion of the authority having jurisdiction, there is danger of physical damage to the fuel containers, protection shall be provided.

Chapter 10 Safeguarding Demolition Operations

10.1 General. In addition to the specific requirements of this chapter, the provisions of Chapter 1 and Chapters 3 through 7 shall be followed, as applicable, for all demolition operations.

10.2 Special Precautions.

10.2.1 Special precautions shall be taken where demolition work is performed in areas where floors are soaked with oil or other flammable liquid; where dust accumulations are present; or where combustible insulation is present in floors, walls, or ceilings/roofs where hot work is being performed. In these situations, charged hose lines of an adequate number and size shall be provided.

10.2.2* Flammable and combustible liquids shall be drained from tanks and machinery reservoirs in a safe manner and removed from the building immediately. Particular attention shall be paid to the removal of residue and sludge accumulations if hot work operations are involved.

10.3 Temporary Heating Equipment.

10.3.1 During cold-weather demolition operations, building heat shall be maintained to allow the operation of sprinklers, hose, and extinguishers in areas not in the process of demolition.

10.3.2 The minimum temperature at the extremities of such areas equipped with wet sprinkler systems shall be 4°C (40°F).

10.4* Smoking. Smoking shall be prohibited throughout the demolition areas.

10.5* Demolition Using Explosives.

10.5.1 If explosives are used in demolition work (implosion), hose lines [at least two of 38 mm (1.5 in.) diameter or one 64 mm (2.5 in.) diameter] shall be provided in the immediate vicinity of the demolition site during the actual detonation.

10.5.2 The required hose lines shall be of sufficient length to be capable of extinguishing any small fire anywhere on the demolition site after detonation.

10.6 Utilities.

10.6.1 Electrical Service. Electrical service shall be reduced to a minimum, and the identity of energized circuits shall be ensured to avoid any uncertainty.

10.6.2 Gas.

10.6.2.1 Prior to demolition, gas supplies shall be turned off and capped at a point outside the building.

10.6.2.2 Gas lines within the building shall be purged after capping unless otherwise permitted by the authority having jurisdiction.

10.7* Fire Cutoffs.

10.7.1 Vertical and horizontal cutoffs shall be retained until razing operations necessitate their removal as permitted by the authority having jurisdiction.

10.7.2 Fire doors shall be closed at the end of each working day.

10.8 Fire Protection During Demolition.

10.8.1 General. The provisions of Chapter 7 shall apply in addition to the specific requirements of this section.

10.8.2* System Operation. Where a building is equipped with sprinklers, the sprinkler protection shall be retained in service as long as the condition requiring the use of sprinklers exists.

10.8.3 Sprinkler Control Valves.

10.8.3.1 The operation of sprinkler control valves shall be permitted only by properly authorized personnel and shall be accompanied by the notification of designated parties.

10.8.3.2 Where the sprinkler protection is regularly turned off and on to facilitate removal and capping of segments, the sprinkler control valves shall be checked at the end of each work shift to ascertain that protection is in service.

10.8.4 Standpipes. Standpipes shall be maintained in conformity with the progress of demolition activity in such a manner that they are always ready for fire department use.

10.8.5* Fire Extinguishing Equipment. Fire extinguishing equipment shall be available subject to the authority having jurisdiction.

Chapter 11 Safeguarding Underground Operations

11.1* General.

11.1.1* In addition to the specific requirements of this chapter, the provisions of Chapter 1 and Chapters 3 through 10 shall apply to all underground operations unless otherwise modified by this chapter.

11.1.2 Drainage systems shall be properly designed and installed to remove water from sprinkler discharge and fire hose streams.

11.1.3 Fire safety for existing, operating, fixed guideway underground transportation systems undergoing alteration or renovation shall be in accordance with NFPA 130, *Standard for Fixed Guideway Transit and Passenger Rail Systems*.

11.1.4 Means of egress for existing, operating, underground structures shall be in accordance with NFPA 101, *Life Safety Code*.

11.1.5 Security.

11.1.5.1 At each aboveground entrance, underground operations shall have a check-in/check-out system, supervised by a qualified individual at all times, that provides an accurate record of each person who is underground.

11.1.5.2 The location of the check-in/check-out system shall be within 7600 mm (300 in.) of the entrance and shall be easily identified.

11.1.6 Completed or unused sections of the underground facility shall be barricaded, properly marked, and made off limits.

11.1.7 Compartmentation by means of the installation of fire and smoke barriers shall be at intervals that limit the extent and severity of the fire and that provide areas of refuge for occupants.

11.1.8 Water Supply.

11.1.8.1 A fire protection water supply system shall be provided in accordance with 8.7.2.1.

11.1.8.2 A standard fitting with outlet threads compatible with the equipment of the local fire department shall be provided so that travel distance does not exceed 46 m (150 ft).

11.2 Emergency Procedures.

11.2.1* Evacuation Plans.

11.2.1.1 A written fire prevention, fire suppression, and emergency evacuation plan shall be developed, maintained, and kept current.

11.2.1.2 The authority having jurisdiction shall be provided with a copy of the current plan for its review and shall have the opportunity to comment on the plan.

11.2.1.3 Special attention shall be given to rescue and smoke-venting procedures, to means of ingress/egress, and to training and orientation of employees and visitors.

11.2.2 All personnel, including visitors, shall be trained in emergency and evacuation procedures and informed of the hazards prior to going underground.

11.2.3 Drills.

11.2.3.1 Underground operations shall conduct disaster and evacuation drills for each shift at least once at the start of underground operations and every 6 months, or more frequently as appropriate.

11.2.3.2 A record of such drills shall be maintained.

11.3 Fire Detection, Protection, and Communications Systems.

11.3.1* Fire Detection and Protection Systems.

11.3.1.1 Fire protection extinguishing equipment applicable to the hazard shall be provided at the head, tail, drive, and take-up pulley areas of belt conveyors and at intervals along belt conveyor lines that shall not exceed 91 m (300 ft).

11.3.1.2 Belt conveyors installed in underground locations, other than belts that carry the load of the belt on a low-friction

metal deck without rollers, shall meet the following minimum requirements:

- (1) Conveyor belting shall be approved.
- (2) Entrances in which belt conveyors are installed shall be kept free of accumulations such as muck, debris, and combustibles.
- (3) All belt conveyors shall be equipped with an approved slippage switch system designed to shut down the belt when sliding friction develops between the drive pulley(s) and the belt, and the following also shall apply:
 - (a) The slippage switch system shall be tested weekly.
 - (b) On each new installation, the slippage switch system shall be tested before the conveyor is used.
- (4) All conveyor belt systems shall be equipped with approved interlock systems that shut down belt conveyors when any conveyor in the system stops or reduces its normal speed or upon activation of any required fire protection system.
- (5) Fixed combustible materials such as posts, cribbing, and roof supports shall be either guarded from contact by the belt using metal or located at a distance of at least $\frac{1}{2}$ the width of the belt from any idler or pulley, and the following also shall apply:
 - (a) An alternate method for minimizing potential frictional ignition is the use of alignment switches at intervals sufficient to prevent the belt from contacting such materials.
 - (b) Guarding for machinery in the drive area and at other points along the belt shall be of noncombustible material.
- (6) New installations of belt conveyors shall utilize a structure that does not provide a deck between the upper and lower strands of the belt.

11.3.1.3 Suitable fire extinguishers shall be installed so that travel distance from any one point in a tunnel does not exceed 91 m (300 ft) on a horizontal plane.

11.3.1.4 Audible and visible alarm and emergency lighting for safe evacuation shall be required.

11.3.2 Fire Communications Systems.

11.3.2.1 Two means of communications with the surface shall be available at all times from all areas of the underground facility.

11.3.2.2 All communications systems shall be tested weekly.

11.4 Electrical.

11.4.1* Electrical cords and plugs shall be heavy duty and suitable for use in damp locations.

11.4.2 Conductors.

11.4.2.1 Conductors shall be located or guarded so as to be protected from physical damage. Multiconductor portable cable shall be permitted to supply mobile equipment.

11.4.2.2 An equipment grounding conductor shall be run with circuit conductors inside the metal raceway or inside the multiconductor cable jacket.

11.4.2.3 The equipment grounding conductor shall be permitted to be insulated or bare.

11.4.3 Oil-filled transformers shall only be used underground where located in a fire-resistant enclosure suitably vented to

the outside and surrounded by a dike to retain the contents of the transformers in the event of rupture.

11.4.4 Enclosures.

11.4.4.1 Bare terminals of transformers, switches, motor controllers, and other equipment shall be enclosed to prevent accidental contact with energized parts.

11.4.4.2 Enclosures for use in tunnels shall be raintight, rain-proof, or watertight as defined in *NFPA 70, National Electrical Code*, where necessitated by the environmental conditions.

11.4.5 Special attention shall be given to maintaining clear access and adequate work space around electrical equipment in accordance with *NFPA 70E, Standard for Electrical Safety in the Workplace*. Proper housekeeping shall be maintained to avoid fire hazards.

11.4.6 All nonenergized metal parts of electrical equipment and metal raceways and cable sheaths shall be effectively grounded and bonded to all metal pipes and rails at the portal and at intervals not exceeding 300 m (1000 ft) throughout the tunnel.

11.5 Hazardous Operations and Procedures.

11.5.1 Hot work operations shall be in accordance with *NFPA 51B, Standard for Fire Prevention During Welding, Cutting, and Other Hot Work*.

11.5.2 A suitable fire extinguisher or other fire control device shall be ready for instant use in any location where hot work is performed.

11.5.3 Acetylene, liquefied petroleum gas (LPG), liquefied oxygen (LOX), and methylacetylene propadiene stabilized gas (MPS) shall be permitted to be used underground only for welding, cutting, and hot work and only if the quality of air is within permitted limits in accordance with the *ACGIH Threshold Limit Values and Biological Exposure Indices for 1992-1993*.

11.5.4 The quantity of combustible materials to be used underground shall be kept to a minimum. Advance planning shall provide for the use of materials having the most favorable combination of high ignition points, low rates of combustion, and low emissions of smoke and harmful gases.

11.5.5 Flammable and Combustible Liquids.

11.5.5.1* Class I flammable liquids shall not be taken, stored, or used underground or within 30 m (100 ft) of a tunnel portal or shaft opening.

11.5.5.2 Class II and Class III liquids shall be transported and stored in approved closed containers, safety cans, or tanks.

11.5.5.3 Quantities shall be limited to those necessary for one work shift.

11.5.5.4 Lubricating oils, greases, and rope dressings taken underground shall be in closed and reclosable approved containers that do not allow the contents to leak or spill.

11.5.5.5 Oil, grease, and diesel fuel stored underground shall be kept in tightly sealed containers in fire-resistant areas located at least 30 m (100 ft) from shafts and inclines.

11.5.5.6 Storage areas shall be positioned or diked so that the contents of ruptured or overturned containers cannot flow from the storage area.

11.5.5.7 Areas within 7600 mm (300 in.) of major electrical installations and unburied tanks for storage of combustible liquids shall be free of transient combustible materials.

11.6 Storage.

11.6.1 No combustible structure shall be erected and no combustible materials shall be stored within 30 m (100 ft) of an access shaft, shaft hoist, or other entry.

11.6.2 Metal containers with self-closing lids shall be provided and used to store combustible waste and debris and shall be removed and taken to the surface daily.

11.7 Equipment.

11.7.1 Less hazardous hydraulic fluids that are listed shall be used in underground machinery and equipment unless the machinery and equipment are protected by an approved fire suppression system or by approved multipurpose fire extinguishers rated at least 4-A:40-B:C.

11.7.2 Wherever self-propelled equipment is used underground, a fire suppression system or a fire extinguisher rated at least 4-A:40-B:C shall be provided on the equipment.

11.7.3* Ventilation.

11.7.3.1 Where single-entry shafts/tunnel ventilation systems are used, they shall be reversible from a location outside and in close proximity to the shaft/tunnel.

11.7.3.2 The ventilation system shall be sufficient for the number of personnel and equipment underground.

11.7.3.3 Air-sampling logs shall be maintained. Air tests shall be conducted before or after each shift.

11.7.3.4 Air-sampling logs shall be available to the authority having jurisdiction.

11.7.3.5 Fan houses, fan bulkheads for main and booster fans, and air ducts connecting main fans to underground openings shall be constructed of noncombustible materials.

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

A.1.1 General requirements applying to construction and demolition are contained in Chapter 1 and Chapters 3 through 7; specific requirements for construction and alteration activities are found in Chapter 8; those requirements specific to roofing operations are covered in Chapter 9; those requirements specific to demolition activities are covered in Chapter 10; and specific requirements for activities in underground locations are contained in Chapter 11.

A.1.3.1 Fires during construction, alteration, or demolition operations are an ever-present threat. The fire potential is inherently greater during these operations than in the completed structure due to previous occupancy hazard and the presence of large quantities of combustible materials and debris, together with such ignition sources as temporary heating devices, cutting/welding/plumber's torch operations, open fires, and smoking. The threat of arson is also greater during construction and demolition operations due to the availability of combustible materials on site and the open access.

Fires during construction, alteration, or demolition operations can be eliminated or controlled through the early planning, scheduling, and implementation of fire prevention measures, fire protection systems, rapid communications, and on-site security.

A.1.3.2 The unique and dangerous situations confronting fire fighters during such operations demand that a complete exchange of pertinent information be established and continued during the life of the project.

A.3.2.1 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

A.3.2.2 Authority Having Jurisdiction (AHJ). The phrase "authority having jurisdiction," or its acronym AHJ, is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

A.3.2.3 Listed. The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

A.3.3.1 Hot Work. As applies to this standard, hot work includes cutting, welding, Thermit welding, brazing, soldering, grinding, thermal spraying, thawing pipe, torch-applied roofing, or any other similar activity.

A.3.3.2 Qualified Agency. Training should be conducted in accordance with manufacturers' instructions or approved industry standards.

A.3.3.5 Structure. Structures include buildings, piers, bridges, and underground installations. Additional definitions of structures are provided in *NFPA 5000, Building Construction and Safety Code*.

A.4.2.1 Separation distances less than those shown in Table 4.2.1 can be used, provided the construction is noncombustible and the combustible loading is limited. For multilevel unsprinklered structures, the authority having jurisdiction should be consulted for separation distances.

The following example illustrates the use of Note (1) to Table 4.2.1:

In Figure A.4.2.1, construction trailers 1 and 2 (CT1 and CT2) are both combustible and present a fire exposure to the main building, which is under construction. The east wall of CT1 and the west wall of CT2 are both 6 m (20 ft) long, are spaced only 3 m (10 ft) apart, and present a fire exposure to each other. According to Table 4.2.1, the separation distance between them should be a minimum of 9 m (30 ft) to prevent fire spread from one to the other. Consequently, in accordance with Note (1) to Table 4.2.1, the south walls of both CT1 and CT2 should be considered a fire exposure to the main building and their lengths should be added to determine the minimum separation distance, S_{min} . Since both walls are 9 m (30 ft) long, the exposing wall length should be taken as 18 m (60 ft), and S_{min} equals 15 m (50 ft).

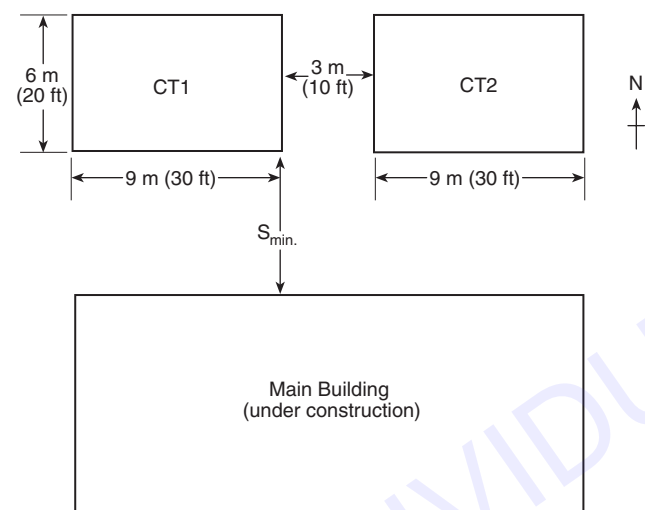


FIGURE A.4.2.1 Example of Application of Note 1 to Table 4.2.1.

A.4.2.2 Where located 9 m (30 ft) or more from the structure and constructed of combustible materials, it is recommended that temporary support buildings be divided into small, detached units to minimize fire loss. Large construction support complexes should be protected with adequate fire protection (e.g., automatic sprinklers, yard hydrants, hose, and extinguishers) as required by the authority having jurisdiction.

A.4.4.1 See NFPA 37, *Standard for the Installation and Use of Stationary Combustion Engines and Gas Turbines*.

A.5.1.1 For a sample permit and procedure, see NFPA 51B, *Standard for Fire Prevention During Welding, Cutting, and Other Hot Work*. Additional fire watches should be provided during welding or cutting operations where sparks or molten metal could drop several floors.

If welding operations have been conducted during a work shift, the guard for the following work shift (*see 7.2.5.1*) should be alerted to check the location where welding was performed as part of his or her regular rounds. Where watch service is not provided, the use of gas-operated welding or cutting equipment should be discontinued for a minimum of 1 hour before the end of the work shift.

Where practicable, work should be moved to a safe location to be welded.

Torches should not be used to cut holes in walls, floors, ceilings, or roofs containing combustible insulation, framing, sheathing, or finish material.

If the structure has a combustible floor, the floor should be wet down or covered with damp sand or sheet metal before and after welding or cutting operations are conducted. Adequate precautions should be taken so that wetting down does not introduce a personnel safety hazard.

A.5.1.4.1 When the charge for Thermit welding has been ignited, the operator should stand several steps away [at least 3000 mm (120 in.)] and should wear goggles. Burns can occur from metal splashing, by upsetting the crucible, by breaking the mold, or by allowing the molten metal to come into contact with moisture in the mold, on the floor, or on the ground.

A.5.1.4.2 Where storage near the point of use is necessary, it should be kept at least 3000 mm (120 in.) away from that point and limited to a supply necessary for one workday. A listed flammable liquid cabinet should be used. The area should be kept dry, and the cabinet should be locked.

It has been reported that moisture can cause ignition. Ferric oxide and powdered aluminum can be used in a metal cylinder as an incendiary bomb, which creates increased concern for keeping storage areas locked.

A.5.2.5 These operations can necessitate the removal of the heater prior to refueling. The appliance also should be allowed to cool prior to refueling.

A.5.2.8 Misuse of temporary heating devices has resulted in numerous fires and millions of dollars in property loss. Temporary heating equipment, while operating, should be visually inspected every hour to ensure that combustibles have not blown or fallen over near the temporary heating device. During windy periods, it might be necessary to reduce the interval between inspections. Any object near the temporary heating device that is hot to the touch should be moved, or the temporary heating device should be relocated. The visual inspection also should ensure that the appliance is operating properly. Any appliance that is not operating properly should be turned off until repairs have been made.

A.5.3.1 Areas where smoking should be prohibited include, but are not limited to, temporary holding areas for combustible construction materials, storage areas, and areas where oil, gasoline, propane, or flammable materials are stored or used.

A.5.4.1 Failure to remove scrap and trash accumulations provides fuel for the rapid expansion of a fire that might otherwise be confined to a small area. These accumulations also provide a convenient fuel source for malicious fires. Open-topped dumpsters containing combustible materials should be emptied or moved to at least 11 m (35 ft) from combustible structures at the end of each work shift.

A.5.4.4.1 An approved safety plan should include the following:

- (1) A fire watch should be in accordance with Section 5.1.
- (2) Adequate fire protection should include sprinklers, hose, extinguishers, or barriers as needed for the particular hazard present, including the construction of the chute.
- (3) Protection of openings in exterior walls and protection of combustible exterior building surfaces should be adjacent to the chute.

- (4) At the end of each work day, provisions should be made to assure that exposure fires are minimized. (See 5.4.1.)
- (5) Trash chutes used in the interior of a building should be of noncombustible construction.
- (6) The main artery of the chute should be as straight as practical to avoid accumulations or clogging within the chute.

A.5.4.4.3 The temporary sprinkler or sprinklers are not required to comply with NFPA 13, *Standard for the Installation of Sprinkler Systems*. Where trash chutes have a length exceeding 11 m (36 ft), intermittent levels of sprinkler protection should be provided at intervals not exceeding 11 m (36 ft). The use of fire retardant coatings can be substituted for sprinkler protection provided that the coating is compatible with the substrate, abrasion resistant, and approved by the authority having jurisdiction.

A.5.5.1.2 The reference to “structure” is intended to apply to those structures under construction, alteration, or demolition and not to temporary structures on the construction site. Additionally, existing properly protected storage within 15 m (50 ft) of the structure or inside an existing structure under alteration is not intended to be regulated by this provision.

A.5.5.2.4 The vapors given off by flammable liquids generally have vapor densities greater than those of air. Therefore, these vapors tend to collect in low spots and travel at floor level. Being invisible, these vapors are difficult to detect without the aid of proper instruments designed specifically for the purpose.

Proper ventilation is, therefore, important in the prevention of accidental ignition of these vapors. Proper ventilation can be accomplished by either natural or mechanical means.

A.7.2.1 One person should be made responsible for the protection of property from fire. This person should ensure that the proper procedures for controlling fire hazards are established and should have full authority to enforce them.

The responsible person should be appointed by the owner. Where an entirely new structure is being constructed, the owner should ensure that specifications for new buildings contain a clause stating that the “contractor will take all reasonable precautions against fire in accordance with good fire protection engineering practice.”

The responsibility for loss prevention is the owner’s. However, loss prevention recommendations normally are accomplished by the contractor. To ensure that recommendations are carried out promptly, the owner’s assistance might be needed.

Fire prevention education should be a topic at contractor safety meetings (“tailgate talks”) at least once a month. Topics that could be discussed include maintaining clear access to fire-fighting equipment, reinforcing cutting and welding procedures, flammable liquids use and storage, use of first aid fire-fighting equipment, roofing operations, and precautions for the use of temporary heating equipment.

All fires should be investigated by the program manager, and necessary fire prevention improvements that are identified by the investigation should be communicated to all employees as soon as possible.

A.7.2.3 Large-scale construction sites change rapidly as construction progresses. The prefire plan should be flexible to allow for different stages of construction. Critical stages that should be considered include access, installation of water mains and fire hydrants, framing/exterior shell, roofing, covering of interior partitions, installation of fixed fire protection, concrete form work, installation of building systems, and construction safety hazards.

Since construction projects do change, the local fire department should be encouraged to visit the site on a regular basis. Prefire plan visits should be scheduled by the manager at least semiannually and when there have been major revisions to the fire prevention plan. Since municipal fire departments work rotating shifts, a series of prefire plan visits might be necessary to allow all responding fire fighters an opportunity to visit the site. In rural areas and smaller cities, the local fire department might be a volunteer organization or might have only a small career fire fighter crew on duty during the day. It might be necessary for the manager to schedule the prefire plan visit during the evening hours to meet the needs of the local fire department.

A.7.2.4.5 See NFPA 101, *Life Safety Code*, for impairments to fire protection systems or fire alarm, detection, or communication systems where required by that code. In addition, see NFPA 72, *National Fire Alarm Code*, for impairments resulting to fire alarm equipment, and NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*, for impairments resulting to water-based fire protection equipment.

A.7.2.5.1 Due to the growing threat of arson, guard service should be provided on major projects even where not required by the authority having jurisdiction. The requirements for guard service also should be based on, but should not be limited to, the hazards at the site, the size of the risk, the difficulty of the fire-fighting situation, the exposure risk, and the physical security of the site.

A.7.2.5.2 It is recommended that areas in buildings should be patrolled at all times when construction, alteration, and demolition operations are not in progress by a competent guard registered on an approved security tour supervision system (watch clock) with stations covering all parts of the building in accordance with NFPA 601, *Standard for Security Services in Fire Loss Prevention*. Guard rounds should include all parts of the buildings and outside areas where hazardous equipment or materials are located. Rounds should be conducted every ½ hour for 2 hours after suspension of work for the day and every hour thereafter during the night and nonworking days and should include tours of all accessible work areas.

A.7.2.5.4 The requirements for security fencing should be based on, but should not be limited to, the hazards at the site, the size of the risk, the difficulty of the fire-fighting situation, the exposure risk, and the presence of guard service.

A.7.2.5.5 Securing the openings (doors and windows) to the structure, where possible, reduces the chance of entry by unauthorized persons. This, in turn, reduces the chance of arson or accidental fires. It could, in some instances, eliminate the need for guard service or security fencing. It also helps prevent freezing or wind damage to fire protection equipment and prevents combustible material from being blown against heating devices and igniting.

A.7.4 In large projects or tall structures, or both, the use of an audible device for an evacuation signal in case of fire or other emergency is recommended.

A.7.7 Portable fire extinguishers, water pails, small hose lines, and 38 mm (1.5 in.) standpipe hose are considered first-aid fire-fighting equipment. To be effective, first-aid fire-fighting equipment should be used in the incipient stage of a fire.

A.7.7.1 A suitable number and type of spare fire extinguishers should be provided on site for immediate replacement of discharged fire extinguishers.

A.7.7.6 Clear and unobstructed access to all first-aid fire-fighting equipment should be maintained. Fire-fighting equipment also should be clearly visible from surrounding areas. If visibility to first aid fire-fighting equipment is obstructed, signs in accordance with NFPA 170, *Standard for Fire Safety and Emergency Symbols*, should be installed to indicate the position of the fire-fighting equipment.

A.8.2 Steel scaffolding or approved fire-retardant lumber and planking should be used on both the outside and inside of the structure. Construction materials (e.g., forms, shoring, bracing, temporary stairways, platforms, tool boxes, plan boxes, solvents, paints, tarpaulins, and similar items) should be of the noncombustible, fire-retardant, safety solvent, or high flash point type, as the case necessitates. A concerted effort should be made to attain as high a level of noncombustibility of materials as possible. (See the definition of the term “fire retardant-treated wood” in NFPA 5000, *Building Construction and Safety Code*.)

A.8.2.5 The authority having jurisdiction should be contacted regarding the adequacy of water supplies for hose lines.

A.8.3.2 Accepted good practice provides sprinklered areas for the storage of interior finish materials and building mechanical equipment, much of which could be received in combustible packaging and which cannot be stored outside due to the absence of exterior space, weather, or security. Even where construction combustibles are not a factor, sprinkler protection should be available for unanticipated early delivery of combustible contents to be used for the permanent occupancy. Where necessary, it is not unusual to plug the extremity of a partially installed sprinkler system temporarily so that a portion can be placed in automatic service.

A.8.6.2.4 Construction tarps would not be considered appropriate barriers or opening protectives.

A.8.7.2.1 No minimum water supply is specified due to the wide range of construction types, sites, and sizes. However, unless combustibles are essentially nonexistent in the completed structure and occupancy, a minimum of 1893 L/min (500 gpm) should be provided. In most instances, the required supply is greater, and authorities having jurisdiction should be consulted.

A.8.7.2.3 It is not intended to prohibit the construction of noncombustible structure foundation elements, such as foundations and footings, prior to the completion of underground water mains and hydrants.

A.8.7.3.1 With proper scheduling and contracting, it is possible for the sprinkler installation to follow the building construction closely as it progresses. This is frequently done in multiple-story buildings to facilitate protection on the lower floors before the upper floors have been built.

A.8.7.4.1.1 Threaded plugs should be inserted in fire department hose connections, and they should be guarded properly against physical damage.

A.8.7.4.1.3 The intent of this provision is to permit the permanent standpipes to be used as temporary standpipes during construction.

A.8.7.4.2.4 A substantial box, preferably of metal, in which a sufficient amount of hose to reach all parts of the floor, appropriate nozzles, spanner wrenches, and hose straps are kept should be maintained at the highest hose outlet.

A.8.7.4.2.8 A supply of fire hose and nozzles should be ordered in advance so that it is available as soon as the standpipes are ready. Hose lines should be connected in areas where construction is in progress.

A.9.2.1 Roofing kettles and all integral working parts should be in good working condition and should be maintained free of excessive residue.

A.9.2.5 Many flammable and combustible liquids, including roofing asphalts, combine readily with the oxygen in air and produce heat. Where these liquids are present on rags and mops used in roofing operations, the heat can concentrate inside the mass faster than it can be dissipated and can result in spontaneous combustion.

Fires on mops can be prevented by “spinning” or cleaning excessive asphalt out of the mop or rag after its work period is finished.

A.9.3 For additional information, see the ARMA publication, *Torch-Applied Roofing, Dos and Don'ts*, and the Factory Mutual Data Sheet 1-33, *Safeguarding Torch-Applied Roof Installations*.

A.9.3.1 Torch-applied roofing can be a potentially hazardous construction process, and extreme caution should be exercised during installation. The exposed outer surface of the membrane coil should be heated until a slight sheen develops. The compound should not be overheated. A slight smoke vapor can be seen when the compound is overheated. The flame from a hand-held torch should be moved from side to side constantly. If a mobile heating apparatus is used, it should be kept in constant motion while in operation.

Some roof membranes, such as polyvinyl chloride (PVC) or chloro-sulfonated polyethylene (CSPE or Hypalon), might necessitate heating or the use of solvents in order to form lap joints or to secure the membrane.

A.9.3.2 Roof openings/vents and crevices should be covered with a stable, noncombustible cover to prevent the ignition of building contents.

Extreme caution should be used near penetrations such as exhaust vents. Flames could ignite grease accumulations from kitchen vents and lint accumulations from laundry vents. Such accumulations should be cleaned before roofing work is begun.

Areas equipped with air conditioning units and ventilating fans should be shut down before torch work is performed.

A torch stand should be used to direct the flame upward while momentarily suspending the use of the flame. The cylinder valve should be closed to burn off propane in the line before shutting off the torch head. The gas supply should be shut off whenever a propane odor is detected.

Torches should not be used near gas lines or electrical wires.

A.9.3.4.2 While there are a number of important safety requirements in NFPA 51B, *Standard for Fire Prevention During Welding, Cutting, and Other Hot Work*, it is impractical to apply the “35 Foot Rule” to torch-applied roofing since the roof cover itself is combustible and such a requirement would prohibit the use of such systems. Requirements in this standard for torch-applied roofing provide safe alternatives to the “35 Foot Rule.”

A.9.3.5 Protective clothing should include acceptable fabrics, a long-sleeve shirt, long pants, gloves, and eye protection. The safe handling of hand torches and hot trowels necessitates the use of proper protective clothing and personal protective equipment.

A.9.3.7 Liquid fuel gas cylinders can be of either the vapor withdrawal or liquid withdrawal type. The vapor withdrawal type draws vapor off the torch head. Vapor withdrawal cylinders are equipped with female cylinder valves. Liquid withdrawal cylinders transfer the liquid, via a dipstick, from the cylinder to the torch head where it is vaporized. Liquid withdrawal cylinders have male cylinder valves, which can come equipped with adapters.

Frost buildup occurs only with vapor withdrawal cylinders. This can be the result of a cylinder that is undersized for the torch or air temperatures that are low. When vapor is drawn off more quickly than it is replaced, heat is absorbed and frost buildup occurs on the outside of the cylinder. Vapor pressure then further declines. Consequently, liquid withdrawal cylinders are recommended. However, where vapor withdrawal cylinders are used, 18 kg (40 lb) or 45 kg (100 lb) cylinders should be used with larger torches (such as those used on the field of the roof) or where temperatures are low [below -7°C (20°F)].

A.9.3.8 Fuel gas cylinders should be inspected for dents. If dents larger than 25 mm (1 in.) in diameter are found, the cylinder should be replaced. Torch and cylinder connectors should be inspected visually and checked for leaks with a soap and water solution. An open flame should not be used to test for leaks.

Leaky equipment should not be used. Regulator adjustments and pressure gauges should be checked to ensure that they are operable. The vent on the regulator should be checked to ensure that it is not blocked. If an unstable flame occurs (e.g., roars loudly and tends to blow itself out), the equipment should be repaired or replaced immediately.

A.9.3.9 All roof areas under repair should be checked for hot spots and signs of smoldering. The inside of the building also should be inspected for signs of fire or smoke. Particular attention should be paid to cants, flashings, and areas around penetrations such as vent pipes, air vents, and skylights. Where available, infrared scanners should be used to detect hot spots. All fires should be reported to the fire department, even when extinguished. Smoldering can continue after extinguishment, can occur for hours before flaming begins, and can occur in areas unsuspected by laypersons. (Also see A.5.1.1.)

A.9.4.1 Additional information regarding the safe use and operation of roofing kettles can be found in NFPA 1, *Fire Code*, Section 16.7.

A.9.4.3 For large roof areas, additional protection, such as charged hose lines or additional extinguishers, is recommended.

A.10.2.2 Tanks and piping formerly containing flammable liquids are likely to contain flammable vapors and should be removed prior to the demolition of a building. If this is not feasible, these hazards should be placarded or otherwise identified for careful removal. Purging with inert materials should be done as early as practicable in the demolition operation in order to minimize the possibility of explosion. Remaining residue or sludge could constitute a fire or explosion hazard. Guidance on draining and inerting tanks can be found in NFPA 30, *Flammable and Combustible Liquids Code*, and NFPA 326, *Standard for the Safeguarding of Tanks and Containers for Entry, Cleaning, or Repair*.

A.10.4 Areas where smoking should be prohibited include, but are not limited to, temporary holding areas for combustible construction materials, storage areas, and areas where oil, gasoline, propane, or flammable material is stored or used.

A.10.5 If buildings are demolished by explosives, work should be performed only by experienced personnel following procedures approved by the authority having jurisdiction.

A.10.7 In situations where adjacent structures are to remain standing, demolition should be started immediately adjacent to the structures to be left standing, thereby creating a space separation between the structures that will remain through the balance of the demolition work.

Vertical open shafts in buildings under demolition have been a major factor in the rapid spread of fire throughout such buildings. Outside chutes should be used where possible so that floor-to-floor integrity can be maintained.

A.10.8.2 The existing sprinklers should be retained in service as long as is reasonable by cutting off and capping the system at the floor or area being razed. Modification of the sprinkler systems to allow alterations or additional demolition should be done under the direction of the authority having jurisdiction and should be expedited so that automatic protection can be restored as quickly as possible.

A.10.8.5 During demolition operations, charged hose lines supplied by hydrants or sprinkler-riser adapters should be available.

A.11.1 The following publications should be consulted for additional information on underground operations and related subjects:

ACGIH *Threshold Limit Values and Biological Exposure Indices for 1992-1993*

ANSI A10.16, *Construction and Demolition — Tunnels, Shafts, and Caissons*

29 CFR 1926, "Safety and Health Regulations for Construction," Subpart S, "Tunnels and Shafts, Caissons, Cofferdams and Compressed Air"

30 CFR 57, "Safety and Health Standards — Underground Metal and Nonmetal Mines"

30 CFR 75, "Mandatory Safety Standards — Underground Coal Mines"

NFPA *Fire Protection Handbook*

NFPA 120, *Standard for Fire Prevention and Control in Coal Mines*

NFPA 122, *Standard for Fire Prevention and Control in Metal/Nonmetal Mining and Metal Mineral Processing Facilities*

A.11.1.1 Underground structures and construction activities present unique fire protection problems, because fires can quickly create temperatures and smoke levels that are intolerable to workers and fire fighters. Due to the unusual circumstances, the complexity and variety of activities regarding underground operations, fire prevention, fire suppression, and emergency evacuation plans should be reviewed with responding fire departments and medical facilities. It is further recommended that fire-fighting personnel be given periodic tours of the underground work areas.

A.11.2.1 An underground emergency evacuation plan should be developed, and the first and foremost consideration of this plan should be the prompt and safe removal of all persons underground. This plan should include, as a minimum, the following:

- (1) Emergency communications and alarm system
- (2) Clear, concise, and uncomplicated emergency instructions
- (3) Location of means of egress from the underground work areas

- (4) Availability and location of self-rescuer air breathing units and first aid supplies
- (5) Emergency ventilation methods
- (6) Location of any refuge stations

A.11.3.1 If an underground location is classified as gassy by the regulatory authorities, additional fire protection and equipment might be needed. For example, continuous monitoring for flammable gas, explosionproof electrical equipment, and other related requirements could be necessary. The authority having jurisdiction over the project should be consulted to determine specific safety and fire prevention needs.

A.11.4.1 See *NFPA 70, National Electrical Code*.

A.11.5.5.1 The use of hazardous materials, liquids, or chemicals underground should be minimized and eliminated where feasible. Strict controls including fire-resistant storage areas vented to the outside should be used.

A.11.7.3 For ventilation requirements, see 29 CFR Part 1926.800, Subpart S.

Annex B Informational References

B.1 Referenced Publications. The following documents or portions thereof listed in this annex are referenced within the informational sections of this standard and are not part of the requirements of this document unless also listed in Chapter 2 for other reasons.

B.1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 1, *Fire Code*, 2009 edition.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 2007 edition.

NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*, 2008 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 2008 edition.

NFPA 37, *Standard for the Installation and Use of Stationary Combustion Engines and Gas Turbines*, 2006 edition.

NFPA 51B, *Standard for Fire Prevention During Welding, Cutting, and Other Hot Work*, 2009 edition.

NFPA 70®, *National Electrical Code*®, 2008 edition.

NFPA 72®, *National Fire Alarm Code*®, 2007 edition.

NFPA 101®, *Life Safety Code*®, 2009 edition.

NFPA 120, *Standard for Fire Prevention and Control in Coal Mines*, 2004 edition.

NFPA 122, *Standard for Fire Prevention and Control in Metal/Nonmetal Mining and Metal Mineral Processing Facilities*, 2004 edition.

NFPA 170, *Standard for Fire Safety and Emergency Symbols*, 2009 edition.

NFPA 326, *Standard for the Safeguarding of Tanks and Containers for Entry, Cleaning, or Repair*, 2005 edition.

NFPA 601, *Standard for Security Services in Fire Loss Prevention*, 2005 edition.

NFPA 5000®, *Building Construction and Safety Code*®, 2009 edition.

Fire Protection Handbook, 20th edition, 2008.

B.1.2 Other Publications.

B.1.2.1 ACGIH Publications. American Conference of Governmental Industrial Hygienists, 1330 Kemper Meadow Drive, Cincinnati, OH 45240-1634.

ACGIH Threshold Limit Values and Biological Exposure Indices for 1992-1993.

B.1.2.2 ANSI Publications. American National Standards Institute, 25 West 43rd Street, 4th floor, New York, NY 10036.

ANSI A10.16, *Construction and Demolition — Tunnels, Shafts, and Caissons*, 1988.

B.1.2.3 ARMA Publications. Asphalt Roofing Manufacturer's Association, 1156 15th Street, N.W., Suite 900, Washington, DC 20005.

Torch-Applied Roofing, Dos and Don'ts, 1986.

B.1.2.4 FM Publications. FM Global, 1301 Atwood Avenue, P.O. Box 7500, Johnston, RI 02919.

FM Data Sheet 1-33, *Safeguarding Torch-Applied Roof Installations*, 1988.

B.1.2.5 U.S. Government Publications. U.S. Government Printing Office, Washington, DC 20402.

Title 29, Code of Federal Regulations, Part 1926, "Safety and Health Regulations for Construction," Subpart S, "Tunnels and Shafts, Caissons, Cofferdams and Compressed Air."

Title 30, Code of Federal Regulations, Part 57, "Safety and Health Standards — Underground Metal and Nonmetal Mines."

Title 30, Code of Federal Regulations, Part 75, "Mandatory Safety Standards — Underground Coal Mines."

B.2 Informational References. (Reserved)

B.3 References for Extracts in Informational Sections. (Reserved)

Index

Copyright © 2008 National Fire Protection Association. All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document that it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of NFPA.

-A-	
Administration Chap. 1	
Application..... 1.3	
Equivalency..... 1.4	
Purpose..... 1.2	
Scope..... 1.1, A.1.1	
Approved	
Definition..... 3.2.1, A.3.2.1	
Authority Having Jurisdiction (AHJ)	
Definition..... 3.2.2, A.3.2.2	
-D-	
Definitions Chap. 3	
-E-	
Explanatory Material Annex A	
-F-	
Fire Protection Chap. 7	
Access for Fire Fighting..... 7.5	
Access Roadways..... 7.5.5	
Hoists and Elevators..... 7.5.7	
Hydrants..... 7.5.8	
Stairs..... 7.5.6	
Fire Alarm Reporting..... 7.4, A.7.4	
Fire Safety Program..... 7.1	
First-Aid Fire-Fighting Equipment..... 7.7, A.7.7	
Installation, Testing, and Maintenance..... 7.3	
Means of Egress..... 7.8	
Owner's Responsibility for Fire Protection..... 7.2	
Prefire Plans..... 7.2.3, A.7.2.3	
Program Manager Responsibilities..... 7.2.4	
Site Security..... 7.2.5	
Standpipes..... 7.6	
-H-	
Hot Work	
Definition..... 3.3.1, A.3.3.1	
-I-	
Informational References Annex B	
-L-	
Listed	
Definition..... 3.2.3, A.3.2.3	
-P-	
Primary Values..... 1.5.2	
Processes and Hazards Chap. 5	
Explosive Materials..... 5.6	
Flammable and Combustible Liquids and Flammable Gases..... 5.5	
Handling of Flammable and Combustible Liquids at Point of Final Use..... 5.5.2	
Storage..... 5.5.1	
Storage and Handling of Combustible and Flammable Gases..... 5.5.3	
Hot Work..... 5.1	
Fire Watch..... 5.1.3	
Thermit Welding..... 5.1.4	
Smoking..... 5.3	
Temporary Heating Equipment..... 5.2	
Waste Disposal..... 5.4	
-Q-	
Qualified Agency	
Definition..... 3.3.2, A.3.3.2	
-R-	
Referenced Publications Chap. 2	
General..... 2.1	
NFPA Publications..... 2.2	
Other Publications..... 2.3	
References for Extracts in Mandatory Sections. (Reserved)..... 2.4	
Roofing Kettle	
Definition..... 3.3.3	
Roofing System	
Definition..... 3.3.4	
Single-Ply Roofing System	
Definition..... 3.3.4.1	
Torch-Applied Roofing System	
Definition..... 3.3.4.2	
-S-	
Safeguarding Construction and Alteration Operations Chap. 8	
Building Separation Walls..... 8.6	
Fire Cutoffs..... 8.6.1	
Temporary Separation Walls..... 8.6.2	
Construction Material and Equipment Storage..... 8.3	
Fire Protection During Construction..... 8.7	
General..... 8.7.1	
Sprinkler Protection..... 8.7.3	
Standpipes..... 8.7.4	
General..... 8.7.4.1	
Standpipe Installations in Buildings Under Construction..... 8.7.4.2	
Water Supply..... 8.7.2	
General..... 8.1	
Permanent Heating Equipment..... 8.4	
Scaffolding, Shoring, and Forms..... 8.2, A.8.2	
Utilities..... 8.5	
Gas..... 8.5.2	
General..... 8.5.1	
Safeguarding Demolition Operations Chap. 10	
Demolition Using Explosives..... 10.5, A.10.5	
Fire Cutoffs..... 10.7, A.10.7	
Fire Protection During Demolition..... 10.8	
Fire Extinguishing Equipment..... 10.8.5, A.10.8.5	
General..... 10.8.1	
Sprinkler Control Valves..... 10.8.3	
Standpipes..... 10.8.4	
System Operation..... 10.8.2, A.10.8.2	
General..... 10.1	
Smoking..... 10.4, A.10.4	
Special Precautions..... 10.2	
Temporary Heating Equipment..... 10.3	

Sequence of Events Leading to Issuance of an NFPA Committee Document

Step 1: Call for Proposals

- Proposed new Document or new edition of an existing Document is entered into one of two yearly revision cycles, and a Call for Proposals is published.

Step 2: Report on Proposals (ROP)

- Committee meets to act on Proposals, to develop its own Proposals, and to prepare its Report.
- Committee votes by written ballot on Proposals. If two-thirds approve, Report goes forward. Lacking two-thirds approval, Report returns to Committee.
- Report on Proposals (ROP) is published for public review and comment.

Step 3: Report on Comments (ROC)

- Committee meets to act on Public Comments to develop its own Comments, and to prepare its report.
- Committee votes by written ballot on Comments. If two-thirds approve, Report goes forward. Lacking two-thirds approval, Report returns to Committee.
- Report on Comments (ROC) is published for public review.

Step 4: Technical Report Session

- “*Notices of intent to make a motion*” are filed, are reviewed, and valid motions are certified for presentation at the Technical Report Session. (“Consent Documents” that have no certified motions bypass the Technical Report Session and proceed to the Standards Council for issuance.)
- NFPA membership meets each June at the Annual Meeting Technical Report Session and acts on Technical Committee Reports (ROP and ROC) for Documents with “certified amending motions.”
- Committee(s) vote on any amendments to Report approved at NFPA Annual Membership Meeting.

Step 5: Standards Council Issuance

- Notification of intent to file an appeal to the Standards Council on Association action must be filed within 20 days of the NFPA Annual Membership Meeting.
- Standards Council decides, based on all evidence, whether or not to issue Document or to take other action, including hearing any appeals.

Committee Membership Classifications

The following classifications apply to Technical Committee members and represent their principal interest in the activity of the committee.

- M *Manufacturer*: A representative of a maker or marketer of a product, assembly, or system, or portion thereof, that is affected by the standard.
- U *User*: A representative of an entity that is subject to the provisions of the standard or that voluntarily uses the standard.
- I/M *Installer/Maintainer*: A representative of an entity that is in the business of installing or maintaining a product, assembly, or system affected by the standard.
- L *Labor*: A labor representative or employee concerned with safety in the workplace.
- R/T *Applied Research/Testing Laboratory*: A representative of an independent testing laboratory or independent applied research organization that promulgates and/or enforces standards.
- E *Enforcing Authority*: A representative of an agency or an organization that promulgates and/or enforces standards.
- I *Insurance*: A representative of an insurance company, broker, agent, bureau, or inspection agency.
- C *Consumer*: A person who is, or represents, the ultimate purchaser of a product, system, or service affected by the standard, but who is not included in the *User* classification.
- SE *Special Expert*: A person not representing any of the previous classifications, but who has a special expertise in the scope of the standard or portion thereof.

NOTES;

1. “Standard” connotes code, standard, recommended practice, or guide.
2. A representative includes an employee.
3. While these classifications will be used by the Standards Council to achieve a balance for Technical Committees, the Standards Council may determine that new classifications of members or unique interests need representation in order to foster the best possible committee deliberations on any project. In this connection, the Standards Council may make appointments as it deems appropriate in the public interest, such as the classification of “Utilities” in the National Electrical Code Committee.
4. Representatives of subsidiaries of any group are generally considered to have the same classification as the parent organization.

NFPA Technical Committee Document Proposal Form

NOTE: All Proposals must be received by 5:00 pm EST/EDST on the published Proposal Closing Date.

For further information on the standards-making process, please contact the Codes and Standards Administration at 617-984-7249 or visit www.nfpa.org/codes.

For technical assistance, please call NFPA at 1-800-344-3555.

FOR OFFICE USE ONLY

Log #: _____

Date Rec'd: _____

Please indicate in which format you wish to receive your ROP/ROC electronic paper download
(Note: If choosing the download option, you must view the ROP/ROC from our website; no copy will be sent to you.)

Date April 1, 200X Name John J. Doe Tel. No. 716-555-1234

Company Air Canada Pilot's Association Email _____

Street Address 123 Summer Street Lane City Lewiston State NY Zip 14092

***If you wish to receive a hard copy, a street address MUST be provided. Deliveries cannot be made to PO boxes.

Please indicate organization represented (if any) _____

1. (a) NFPA Document Title National Fuel Gas Code NFPA No. & Year 54, 200X Edition

(b) Section/Paragraph 3.3

2. Proposal Recommends (check one): new text revised text deleted text

3. Proposal (include proposed new or revised wording, or identification of wording to be deleted): [Note: Proposed text should be in legislative format; i.e., use underscore to denote wording to be inserted (inserted wording) and strike-through to denote wording to be deleted (~~deleted wording~~).]

Revise definition of effective ground-fault current path to read:

3.3.78 Effective Ground-Fault Current Path. An intentionally constructed, permanent, low impedance electrically conductive path designed and intended to carry underground electric fault current conditions from the point of a ground fault on a wiring system to the electrical supply source.

4. Statement of Problem and Substantiation for Proposal: (Note: State the problem that would be resolved by your recommendation; give the specific reason for your Proposal, including copies of tests, research papers, fire experience, etc. If more than 200 words, it may be abstracted for publication.)

Change uses proper electrical terms.

5. Copyright Assignment

(a) I am the author of the text or other material (such as illustrations, graphs) proposed in this Proposal.

(b) Some or all of the text or other material proposed in this Proposal was not authored by me. Its source is as follows (please identify which material and provide complete information on its source):

ABC Co.

I agree that any material that I author, either individually or with others, in connection with work performed by an NFPA Technical Committee shall be considered to be works made for hire for the NFPA. To the extent that I retain any rights in copyright as to such material, or as to any other material authored by me that I submit for the use of an NFPA Technical Committee in the drafting of an NFPA code, standard, or other NFPA document, I hereby grant and assign all and full rights in copyright to the NFPA. I further agree and acknowledge that I acquire no rights in any publication of the NFPA and that copyright and all rights in materials produced by NFPA Technical Committees are owned by the NFPA and that the NFPA may register copyright in its own name.

Signature (Required) _____

PLEASE USE SEPARATE FORM FOR EACH PROPOSAL • email: proposals_comments@nfpa.org • NFPA Fax: (617) 770-3500
Mail to: Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471

NFPA Technical Committee Document Proposal Form

NOTE: All Proposals must be received by 5:00 pm EST/EDST on the published Proposal Closing Date.

For further information on the standards-making process, please contact the Codes and Standards Administration at 617-984-7249 or visit www.nfpa.org/codes.
For technical assistance, please call NFPA at 1-800-344-3555.

FOR OFFICE USE ONLY
Log #: _____
Date Rec'd: _____

Please indicate in which format you wish to receive your ROP/ROC electronic paper download
(Note: If choosing the download option, you must view the ROP/ROC from our website; no copy will be sent to you.)

Date _____ Name _____ Tel. No. _____
Company _____ Email _____
Street Address _____ City _____ State _____ Zip _____

***If you wish to receive a hard copy, a street address MUST be provided. Deliveries cannot be made to PO boxes.

Please indicate organization represented (if any) _____

1. (a) NFPA Document Title _____ NFPA No. & Year _____
(b) Section/Paragraph _____

2. Proposal Recommends (check one): new text revised text deleted text

3. Proposal (include proposed new or revised wording, or identification of wording to be deleted): [Note: Proposed text should be in legislative format; i.e., use underscore to denote wording to be inserted (inserted wording) and strike-through to denote wording to be deleted (~~deleted wording~~).]

4. Statement of Problem and Substantiation for Proposal: (Note: State the problem that would be resolved by your recommendation; give the specific reason for your Proposal, including copies of tests, research papers, fire experience, etc. If more than 200 words, it may be abstracted for publication.)

5. Copyright Assignment

- (a) I am the author of the text or other material (such as illustrations, graphs) proposed in this Proposal.
- (b) Some or all of the text or other material proposed in this Proposal was not authored by me. Its source is as follows (please identify which material and provide complete information on its source):

I agree that any material that I author, either individually or with others, in connection with work performed by an NFPA Technical Committee shall be considered to be works made for hire for the NFPA. To the extent that I retain any rights in copyright as to such material, or as to any other material authored by me that I submit for the use of an NFPA Technical Committee in the drafting of an NFPA code, standard, or other NFPA document, I hereby grant and assign all and full rights in copyright to the NFPA. I further agree and acknowledge that I acquire no rights in any publication of the NFPA and that copyright and all rights in materials produced by NFPA Technical Committees are owned by the NFPA and that the NFPA may register copyright in its own name.

Signature (Required) _____

PLEASE USE SEPARATE FORM FOR EACH PROPOSAL • email: proposals_comments@nfpa.org • NFPA Fax: (617) 770-3500
Mail to: Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471